

Data sheet | Item number: 2002-474

Staggered jumper; insulated; 4-way; Nominal current 25 A; suitable for 2002 and 2003 Series rail-mounted terminal blocks; light gray

www.wago.com/2002-474



Data

Electrical data

Ratings per IEC/EN 60664-1

Rated voltage (III / 3)	400 V
Rated impulse voltage (III / 3)	6 kV
Rated current	25 A

Subject to changes. Please also observe the further product documentation!

WAGO Kontakttechnik GmbH & Co. KG
Hansastr. 27
32423 Minden
Phone: +49571 887-0 | Fax: +49571 887-169
Email: info.de@wago.com | Web: www.wago.com

Do you have any questions about our products?
We are always happy to take your call at +49 (571) 887-44222.



Geometrical Data

Width	19.5 mm / 0.768 inch
-------	----------------------

Material Data

Color	light gray
Fire load	0.036 MJ
Weight	2 g

Commercial data

Product Group	22 (TOPJOB S)
Packaging type	bag
Country of origin	DE
GTIN	4055143692274
Customs Tariff No.	85366990990

Counterpart

Downloads

Documentation

Bid Text

2002-474 doc - Datei	Apr 27, 2017	doc 24.6 kB	Download
2002-474 GAEB X81 - Datei	Feb 19, 2019	xml 2.7 kB	Download

Additional Information

Technical explanations	Apr 3, 2019	pdf 2.1 MB	Download
------------------------	-------------	---------------	----------

CAD/CAE-Data

CAD data


2D/3D Models 2002-474	URL	Download
-----------------------	-----	----------

CAE data


Subject to changes. Please also observe the further product documentation!

Installation Notes

Jumpered

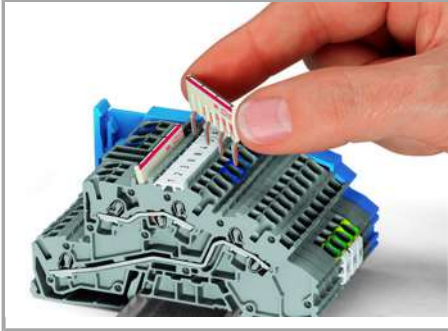

Locate red stripes of the staggered jumpers on the inside.

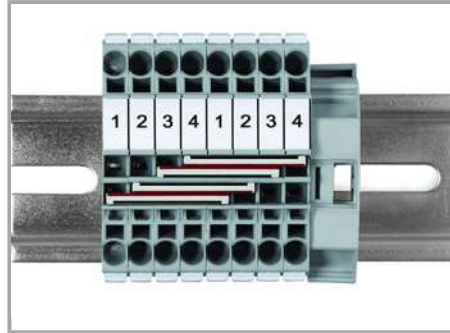

Commoning two potentials in one single jumper slot via extremely slim staggered jumpers.

Insert staggered jumper and push down until it hits backstop.

Jumpered




Locate red stripes of the staggered jumpers on the inside.

Insert staggered jumper and push down until it hits backstop.

Jumpered


Subject to changes. Please also observe the further product documentation!

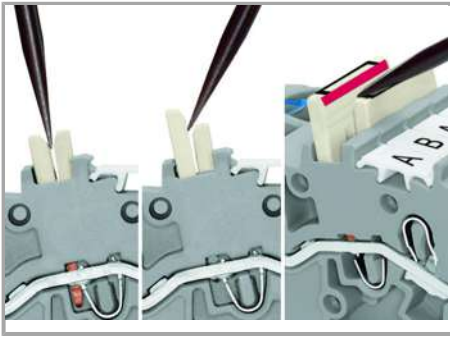


Removing a staggered jumper:

Insert the operating tool between the staggered jumpers, then lift up the jumper.

Jumpered

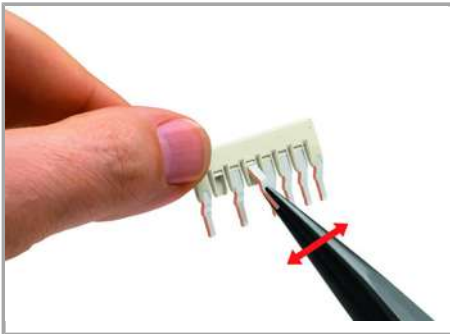

Staggered jumper (seven contacts)

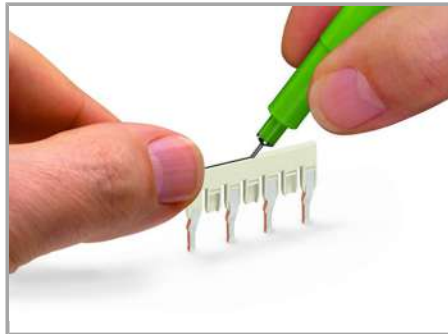

Marking a staggered jumper using a felt-tip pen.

Individual jumper contacts can be broken off by bending them. The remaining piece of insulation will meet requirements for clearances and creepage distances.

Subject to changes. Please also observe the further product documentation!



Staggering jumpers in a single jumper slot.

When creating custom staggered jumpers (e. g., for bridging over a terminal block with a different potential), make sure that only one contact lug is in contact with the terminal block.

The contact lugs of the customized staggered jumpers contact the terminal blocks via the gaps created in the second jumper.

Insert and press the ready-made jumper assembly into the jumper slot until it hits backstop.

Product family

TOPJOB® S

TOPJOB® S: In various industrial applications and modern building installations, WAGO's wide and versatile range of rail-mount terminal blocks provides more than just reliable electrical connections.

[Show all products from the family](#)

Subject to changes. Please also observe the further product documentation!